

Recombinant Cluster Of Differentiation 5 (CD5)

Catalog No.: TD-TP01521 50µg

Sequence Information

Species: Human

Gene ID:921

Swiss Prot:P06127

Synonyms:EWS-ATF1; FUS/ATF-1; TREB36;

Cyclic AMP-Dependent Transcription
Factor

Residues:Arg25~Pro372

RLSWYDPDFQARLTRNSKCGQLEVYLKDGWHMVCSQSWGRSSKQWEDPSQAS
KVCQRLNCGVPLSLGPFVLYTYPQSSIICYGQLGSFSNCSHSRNDMCHSLGLTC
LEPQKTTPTTRPPPTTTPEPTAPPRLQLVAQSGGQHCAGVVEFYSGSLGGTIS
YEAQDKTQDLENFLCNLQCGSFLKHLPETEAGRAQDPGEPREHQPLPIQWKIQ
NSSCTSLEHCFRRIKPKQSGRVLALLCSGFQPKVQSRLVGGSSICEGTVEVRQG
AQWAALCDSSSARSSLRWEVCREQQCGSVNSYRVLDAGDPTSRGLFCPHQKLS
QCHELWERNZYCKKVFVTCQDPNP

Product Information

Source: Prokaryotic expression.

Host: *E. coli*

Tags: N-terminal His Tag

Subcellular Location: Membrane.

Purity: >90%

Traits: Freeze-dried powder

Buffer formulation: PBS, pH7.4, containing 0.1% SKL, 5% Trehalose.

Original Concentration: 100µg/mL

Applications: Positive Control; Immunogen; SDS-PAGE; WB.

(May be suitable for use in other assays to be determined by the end user.)

Predicted isoelectric point: 7.9

Predicted Molecular Mass: 42.4kDa

Accurate Molecular Mass: 43kDa as determined by SDS-PAGE reducing conditions.

[USAGE]

Reconstitute in ddH₂O to a concentration of 0.1-0.5 mg/mL. Do not vortex.

[STORAGE AND STABILITY]

电话: 027-87561633 手机: 189-8623-2100

QQ客服: 121545059 网址: <http://www.itiande-neuron.com>

公司地址: 武汉东湖新技术开发区高新大道666号光谷生物城生物创新园B1栋b274-9室

Storage: Avoid repeated freeze/thaw cycles.

Store at 2-8°C for one month.

Aliquot and store at -80°C for 12 months.

Stability Test: The thermal stability is described by the loss rate. The loss rate was determined by accelerated thermal degradation test, that is, incubate the protein at 37°C for 48h, and no obvious degradation and precipitation were observed. The loss rate is less than 5% within the expiration date under appropriate storage condition.

[IDENTIFICATION]

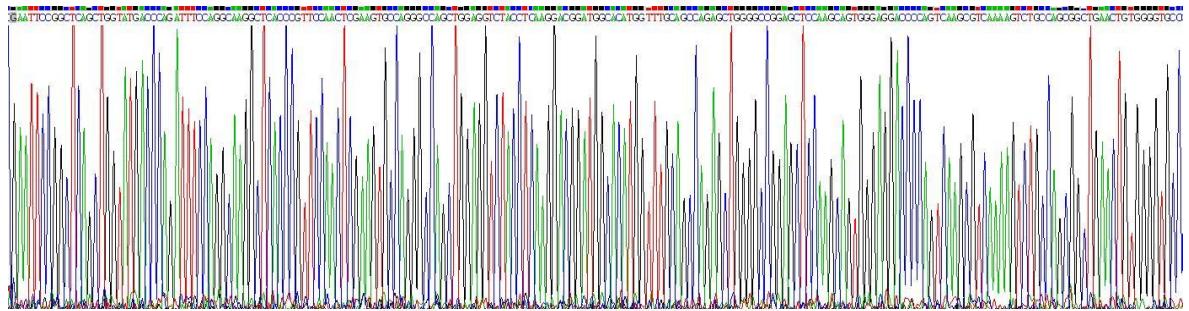


Figure 1. Gene Sequencing (Extract)

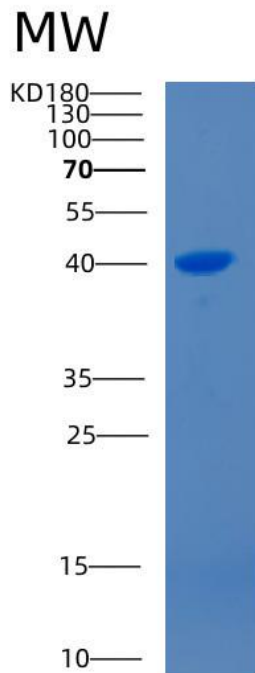


Figure 2. SDS-PAGE

[IMPORTANT NOTE]

The kit is designed for in vitro and research use only, we will not be responsible for any issue if the kit was used in clinical diagnostic or any other procedures.

